


24 x 36 - 9' Garage Plan Plan #g271 By SDS-CAD Specialized Design Systems

Page 1 Title Page
Page 2 Main Floor Plan
Page 3 Foundation Plan
Page 4 Elevation Views
Page 5 Framing and Details
Page 6 Typical Section
Page 7 Materials List

30 year dimensional shingles and Sturdy Panel Siding or T111 or Structural Panel exterior running vertical with 8" on center groove. Nailing schedule is 6" on ends 12" on centers 6d nails. Trusses are engineered on 24" and framing is 2" x 4" on 16" centers. 9' ceiling height.

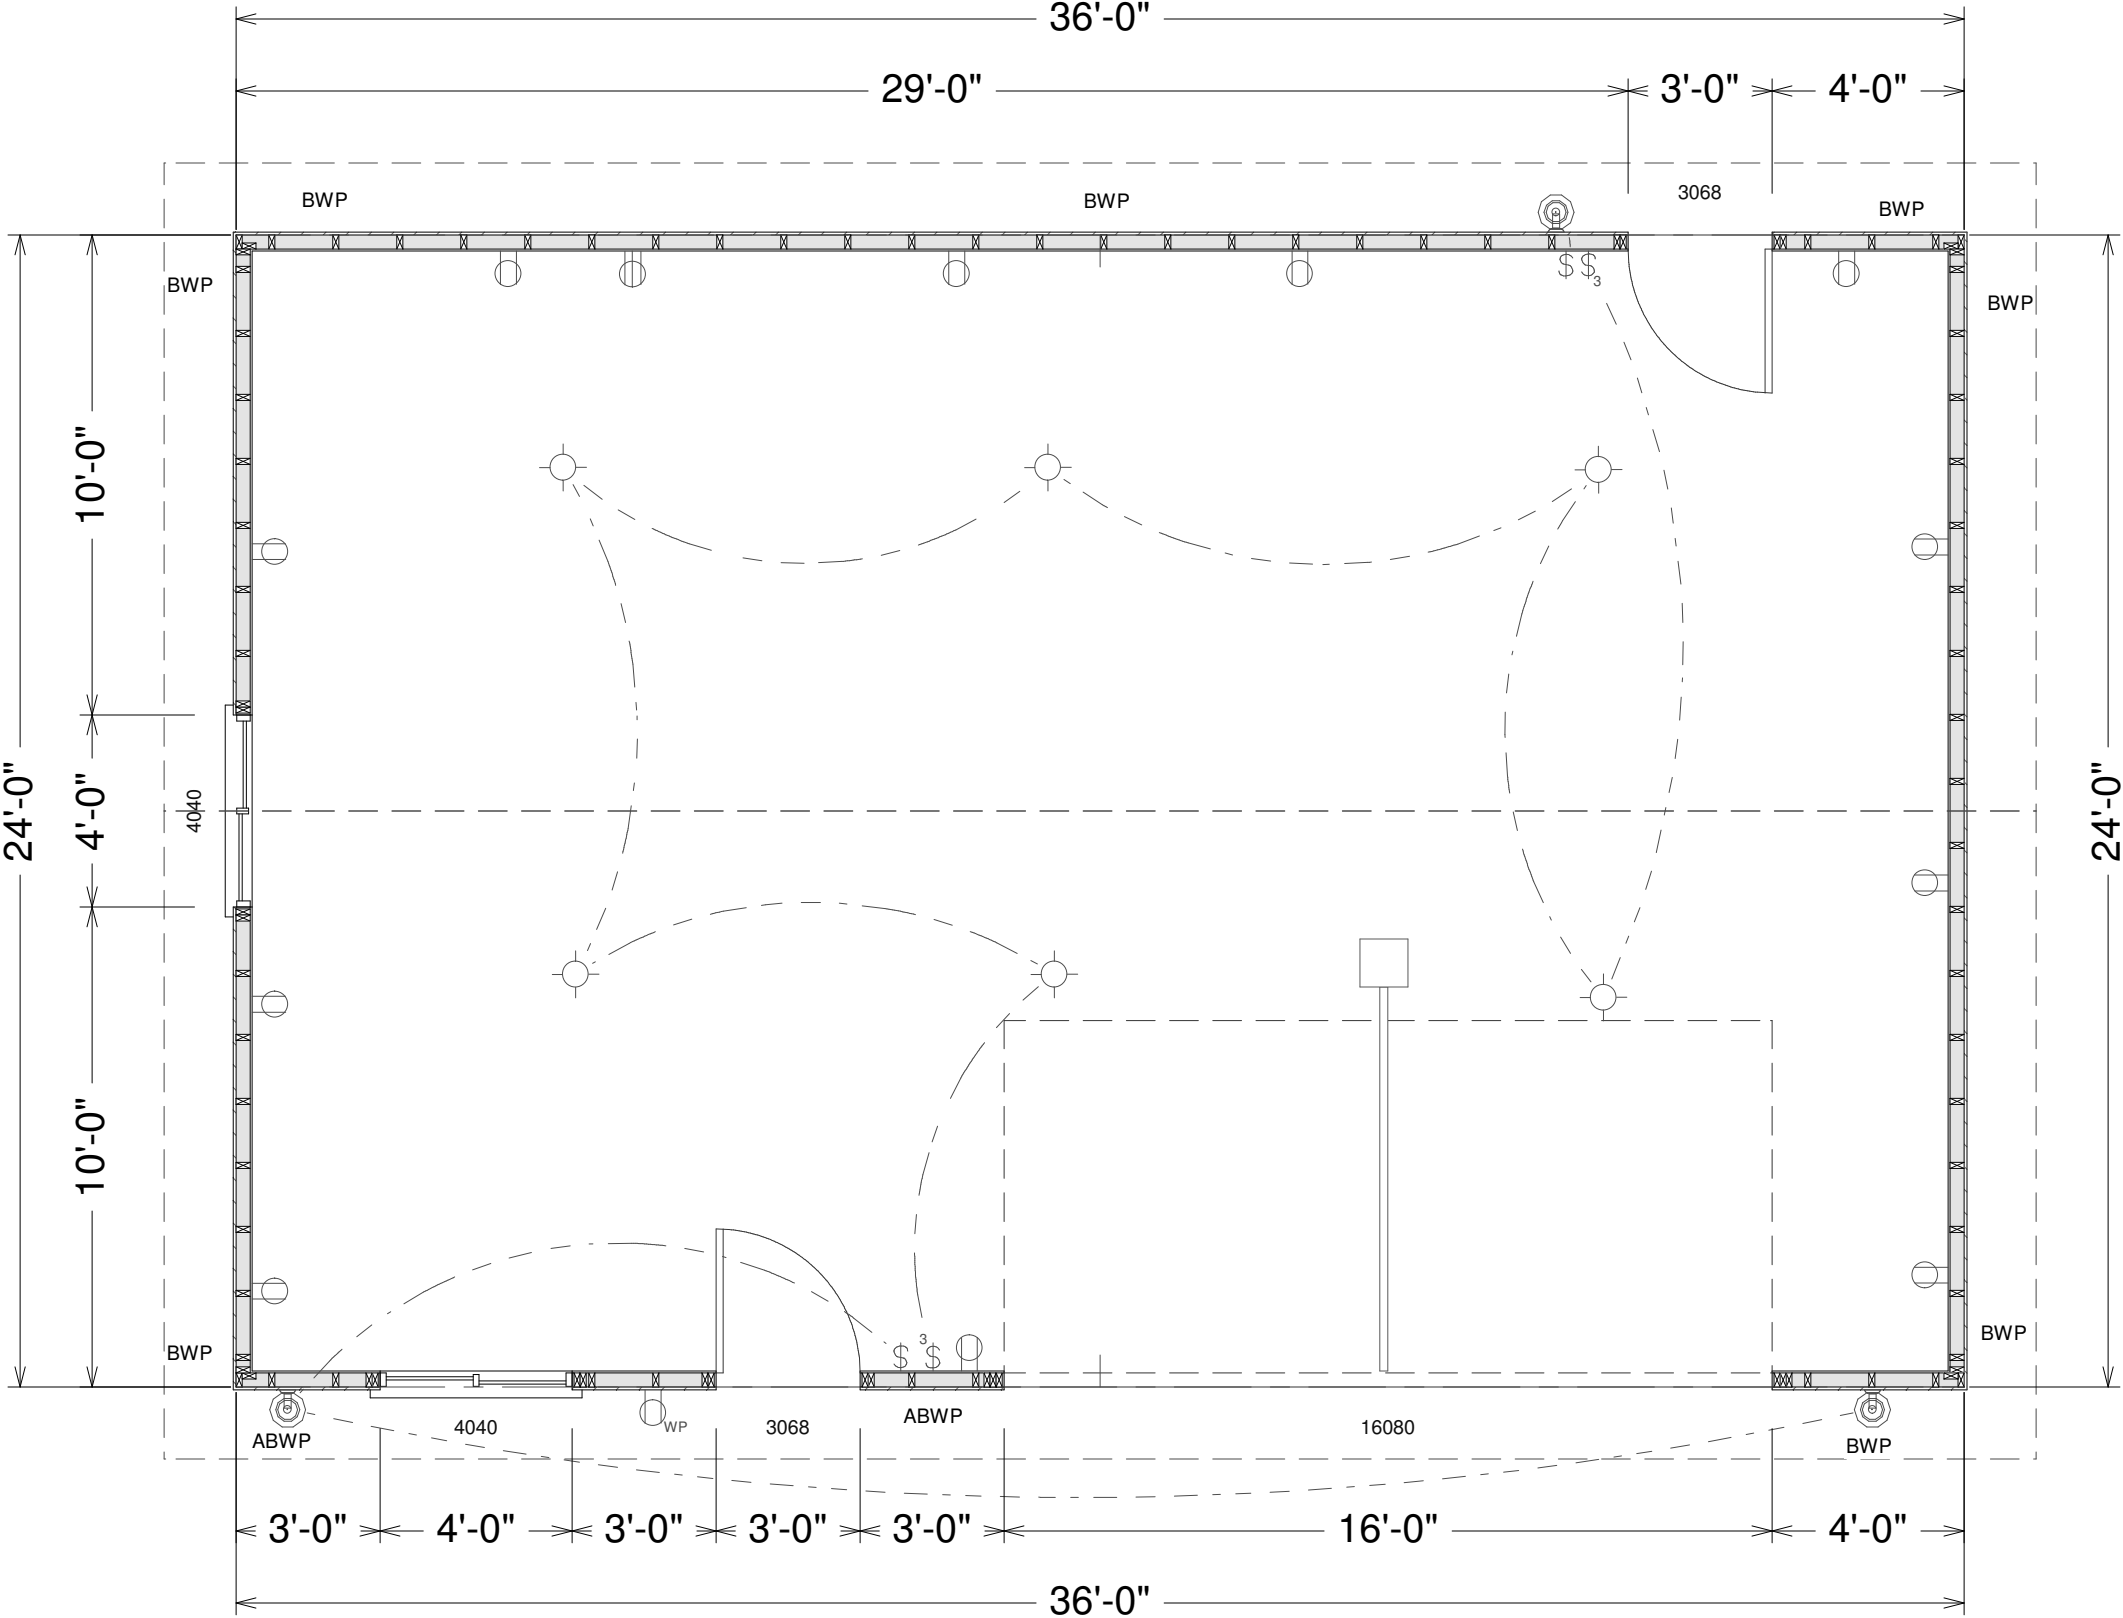

GARAGE MAIN FLOOR PLAN

SCALE 1/4"=1'

Residential Design

SDS-CAD
Specialized Design Systems

Garage for

CLIENT

DATE

DRAWN BY

CHKD BY

DATE

REVISIONS


JOB NO.

SHEET NO.
2
OF
7




Concrete:

1. All slabs are to be 4" concrete over 4" gravel unless otherwise noted on the plans.
2. Concrete to be ACI 301-66, Type II cement, 2500 psi at 28 days, 5" maximum slump.
3. Reinforcing to be ASTM A615-Bars with $F_y=60$ ksi lap 30 diameter minimum at splices or weld per ACI Std.
4. Concrete design based on F_c 2000 psf, F_c 2500 psi for quality only.
5. Anchor bolts shall be A-307 embedded 7" minimum into concrete or masonry grout.
6. All footings minimum 24" below final grade

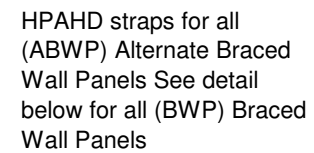


N.T.S.




FOUNDATION PLAN


SCALE 1/8"=1'

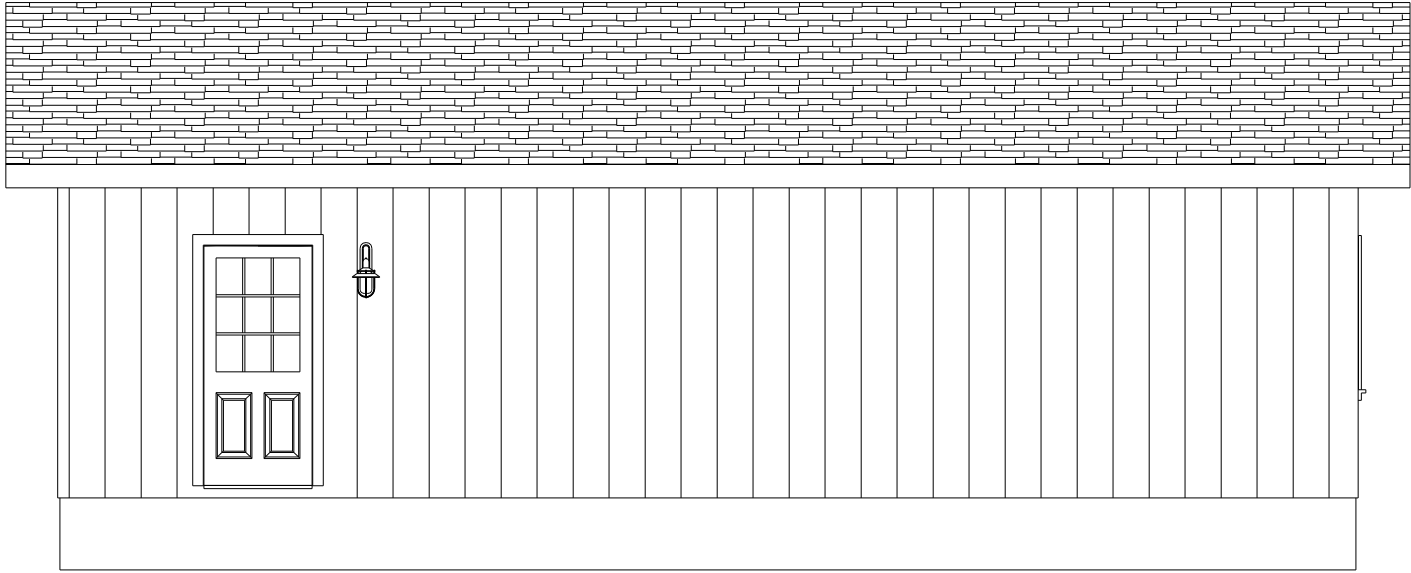


REAR ELEVATION
SCALE 3/16=1'

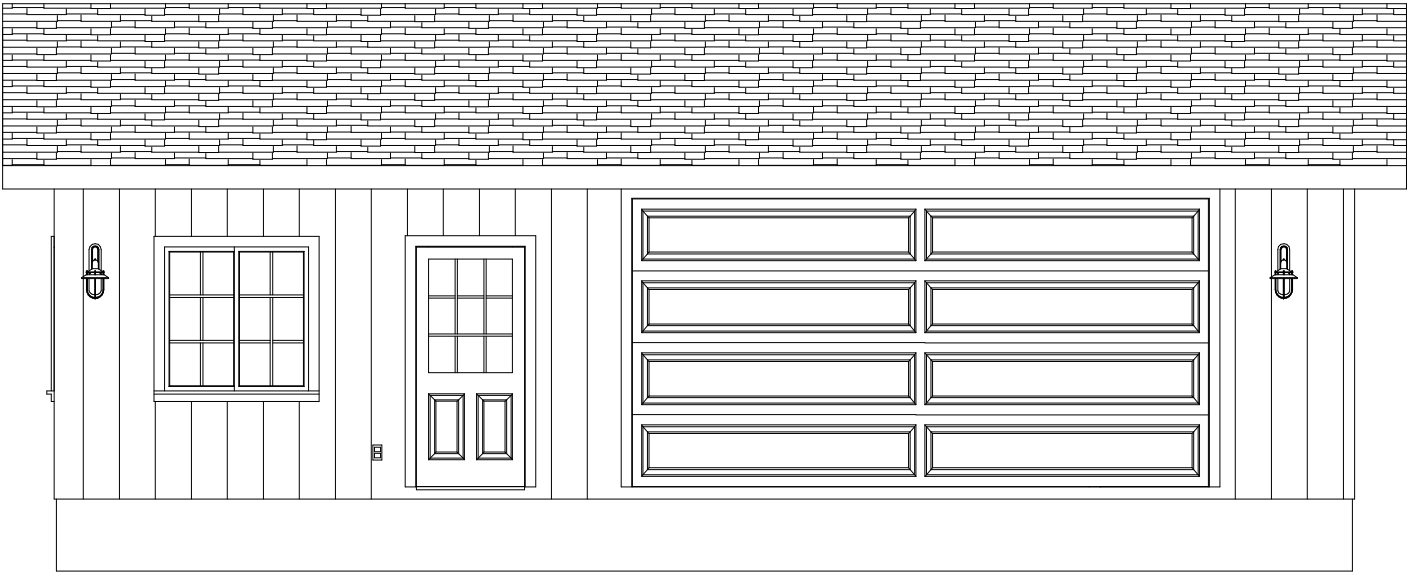

FRONT ELEVATION
SCALE 3/16=1'

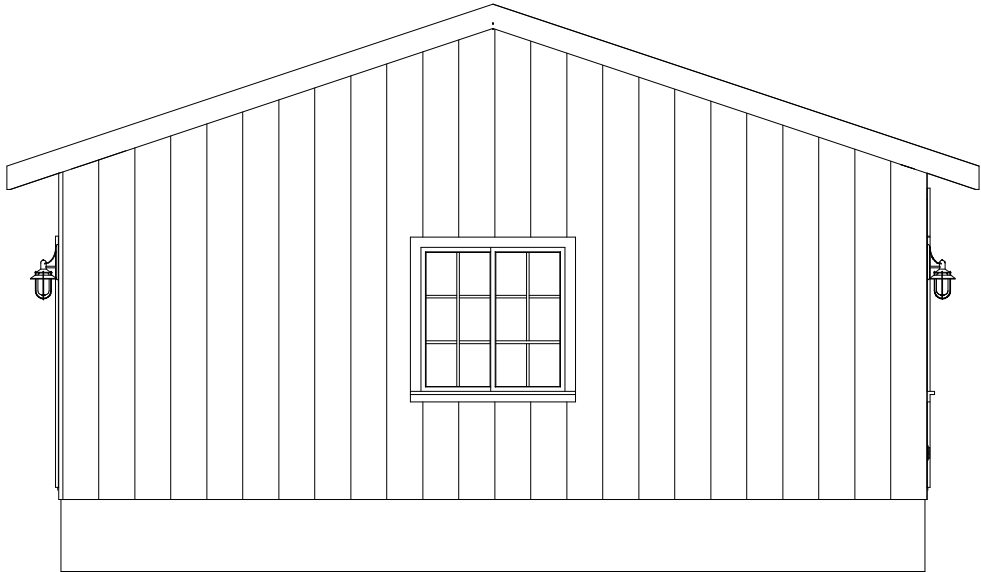

LEFT ELEVATION
SCALE 3/16=1'

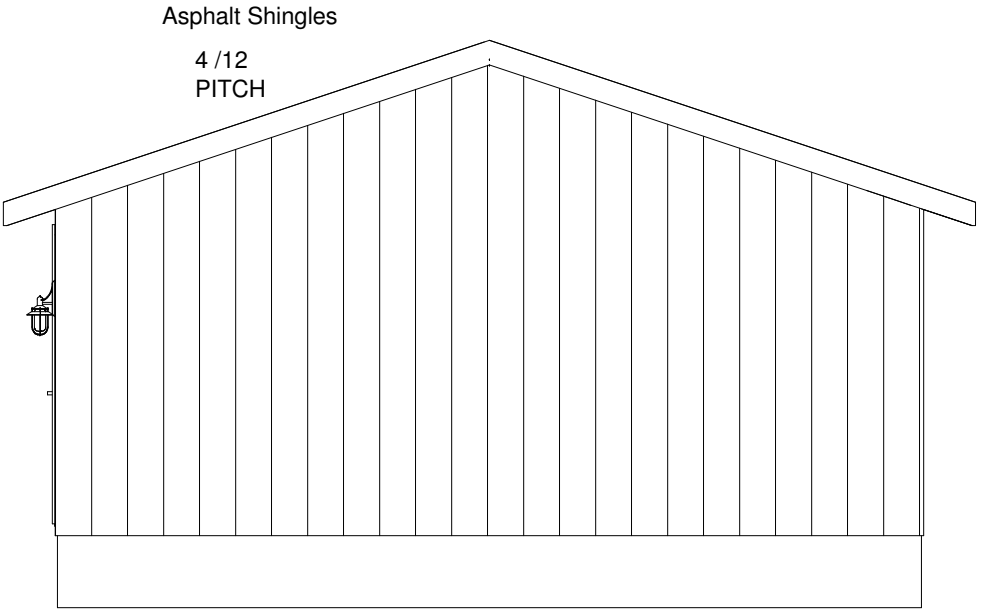

RIGHT ELEVATION
SCALE 3/16=1'

9' Tall 2 x Walls
Sturdy Panel
Structural
Siding or other
Structural
Exterior Grade
Finish

Asphalt Shingles
4 /12
PITCH

Residential Design

SDS-CAD
Specialized Design Systems

Garage for

CLIENT

DATE

DRAWN BY


CHECKED BY

DATE


REVISIONS

JOB NO.


SHEET NO.
4
of
7

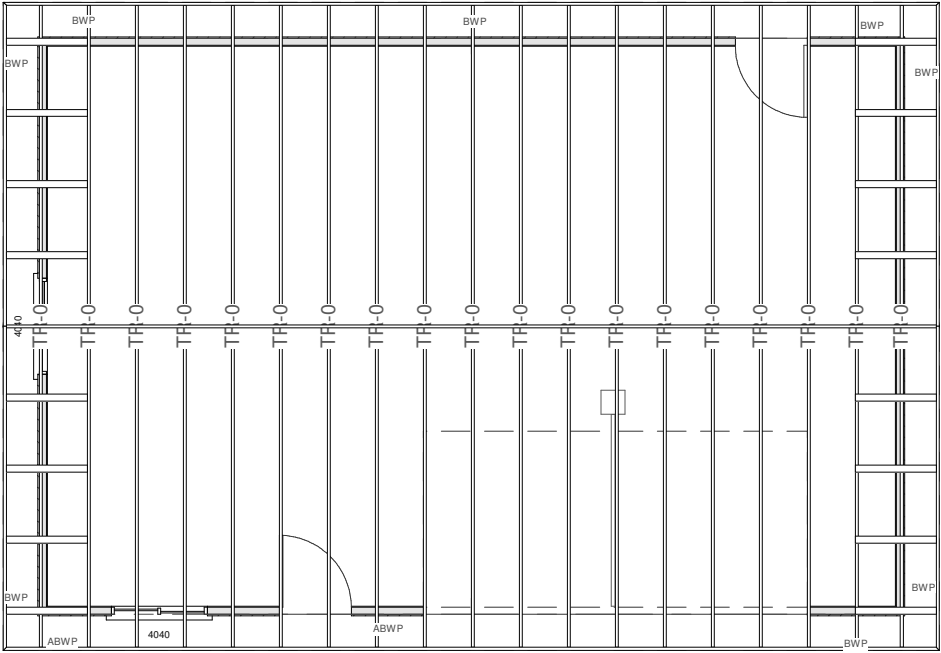



GARAGE ROOF PRE-ENGINEERED TRUSSES AS SUPPLIED BY TRUSS MANUFACTURER 24" o.c.

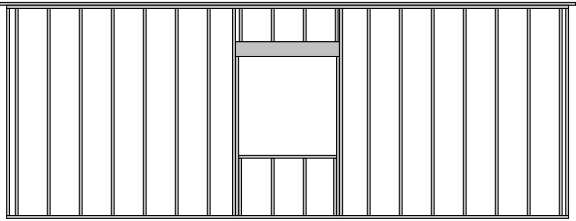


End Walls

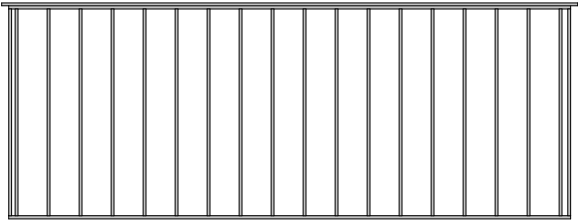

9' Tall 2 x Walls

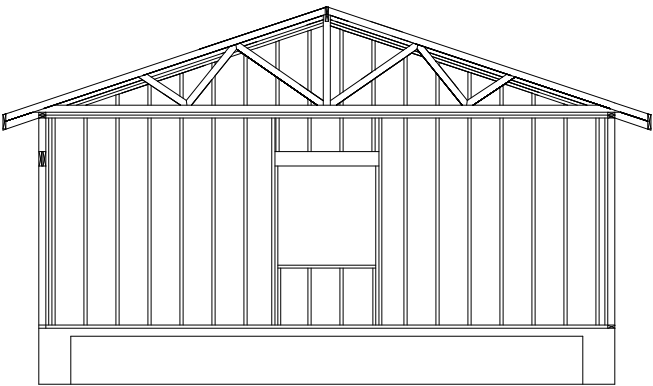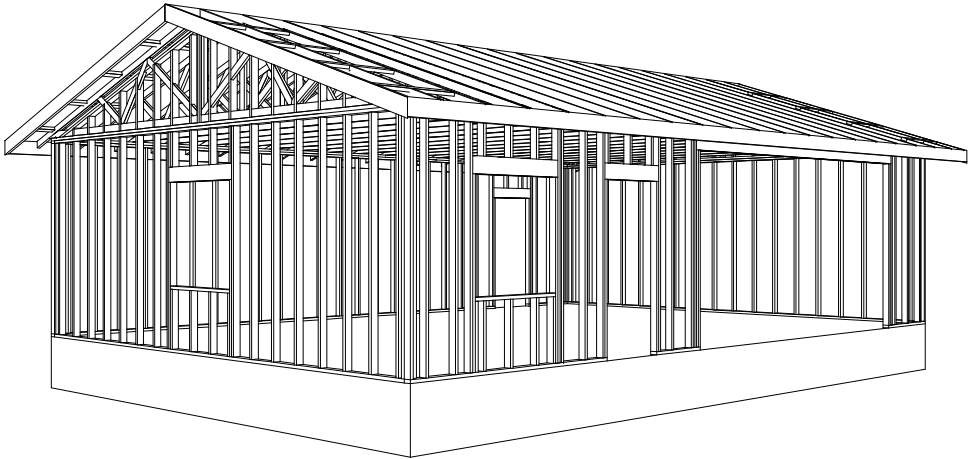

Cross Section

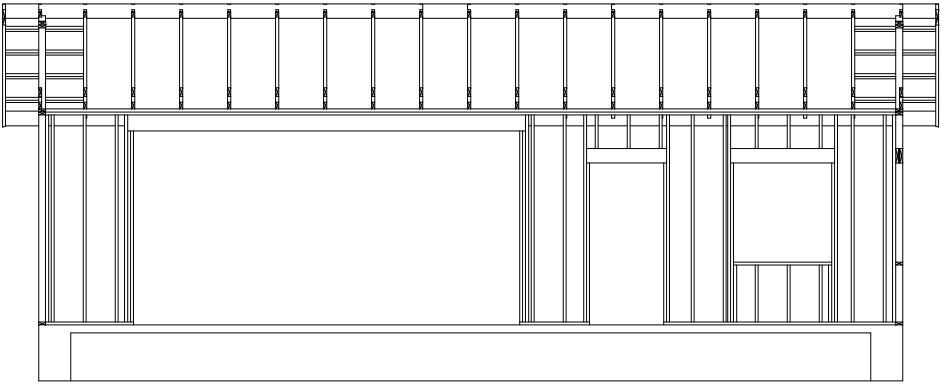

Front Wall

WALL FRAMING SECTIONS


SCALE 1/8"=1'

Roof Framing:

1. Fascia to be 2"x Douglas Fir.
2. For soffit size see details.
3. For spans and dimensions refer to floor plans.
4. Trusses are to be an approved truss design from the truss manufacture's engineer.
5. Use Simpson H-1 hurricane anchors at each truss or rafter to wall connection.
6. Solid blocking required between joists, rafters, and trusses over all bearing walls. Such blocking shall be 1 1/2" minimum thickness and full depth of joists, rafters, or trusses.
7. Minimum header sizes shall be according to the header size table unless otherwise noted.
8. Basis of design roof live/snow load of 37 psf, and roof dead load of 15 psf.
9. Plywood roof decking to be Min 1/2" thick, 24/0, CDX or 5/8 wafer.

General framing: (Douglas Fir)

1. Minimum header sizes shall be according to the following table unless otherwise noted. Header sizes (single story construction)
2'-0" to 4'-0" Span 2-2x4's
4' + to 6'-0" Span 2-2x6's
6' + to 8'-0" Span 2-2x8's
8' + to 10'-0" Span 2-2x10's
10' + to 12'-0" Span 2-2x12's or as noted on plan
2. Brace all exterior walls and cross-stud partitions at each end of building and at least every 25' of length by one of the following:
 - a. Simpson WB 126 wall bracing with 3-16d nails at each end and 1-8d nails at each stud.
 - b. Plywood sheathing of a minimum thickness of 7/16 inch.
3. Fire stopping:
 - a. Fireblock stud spaces over 10' in height, furred spaces, soffits, drop ceilings, cove ceilings, stair stringers at top and bottom of run, bearing walls and ceiling joist lines, etc. Firestopping shall consist of 2" nominal lumber.
 - b. Firestop openings around vents, pipes, ducts, chimneys, and fireplaces at ceiling and floor levels with approved noncombustible materials.
4. CDX plywood is not approved where exposed to weather, i.e., roof overhangs.
5. Exterior wall framing to be 2"x4" studs at 16" o.c. Interior wall, framing at non-bearing walls to be 2"x4" studs at 24" o.c. and at bearing walls 2"x4" studs at 16" o.c. with double top plate. Shear wall to be 7/16" Sheathing, see detail.
6. All stress grade lumber shall comply with WCLA specs and bear approval stamp on all pieces in place.
7. Framing lumber shall be Douglas Fir construction grade Fb 1450 or better unless otherwise noted.
8. Nailing to be per current U.B.C. unless otherwise noted.
9. All bearing partitions shall have double top plates.
10. Structural glued laminated timbers to be stamped by an approved agency.
11. Use redwood or pressure treated sole plates at all exterior walls.
- 12.

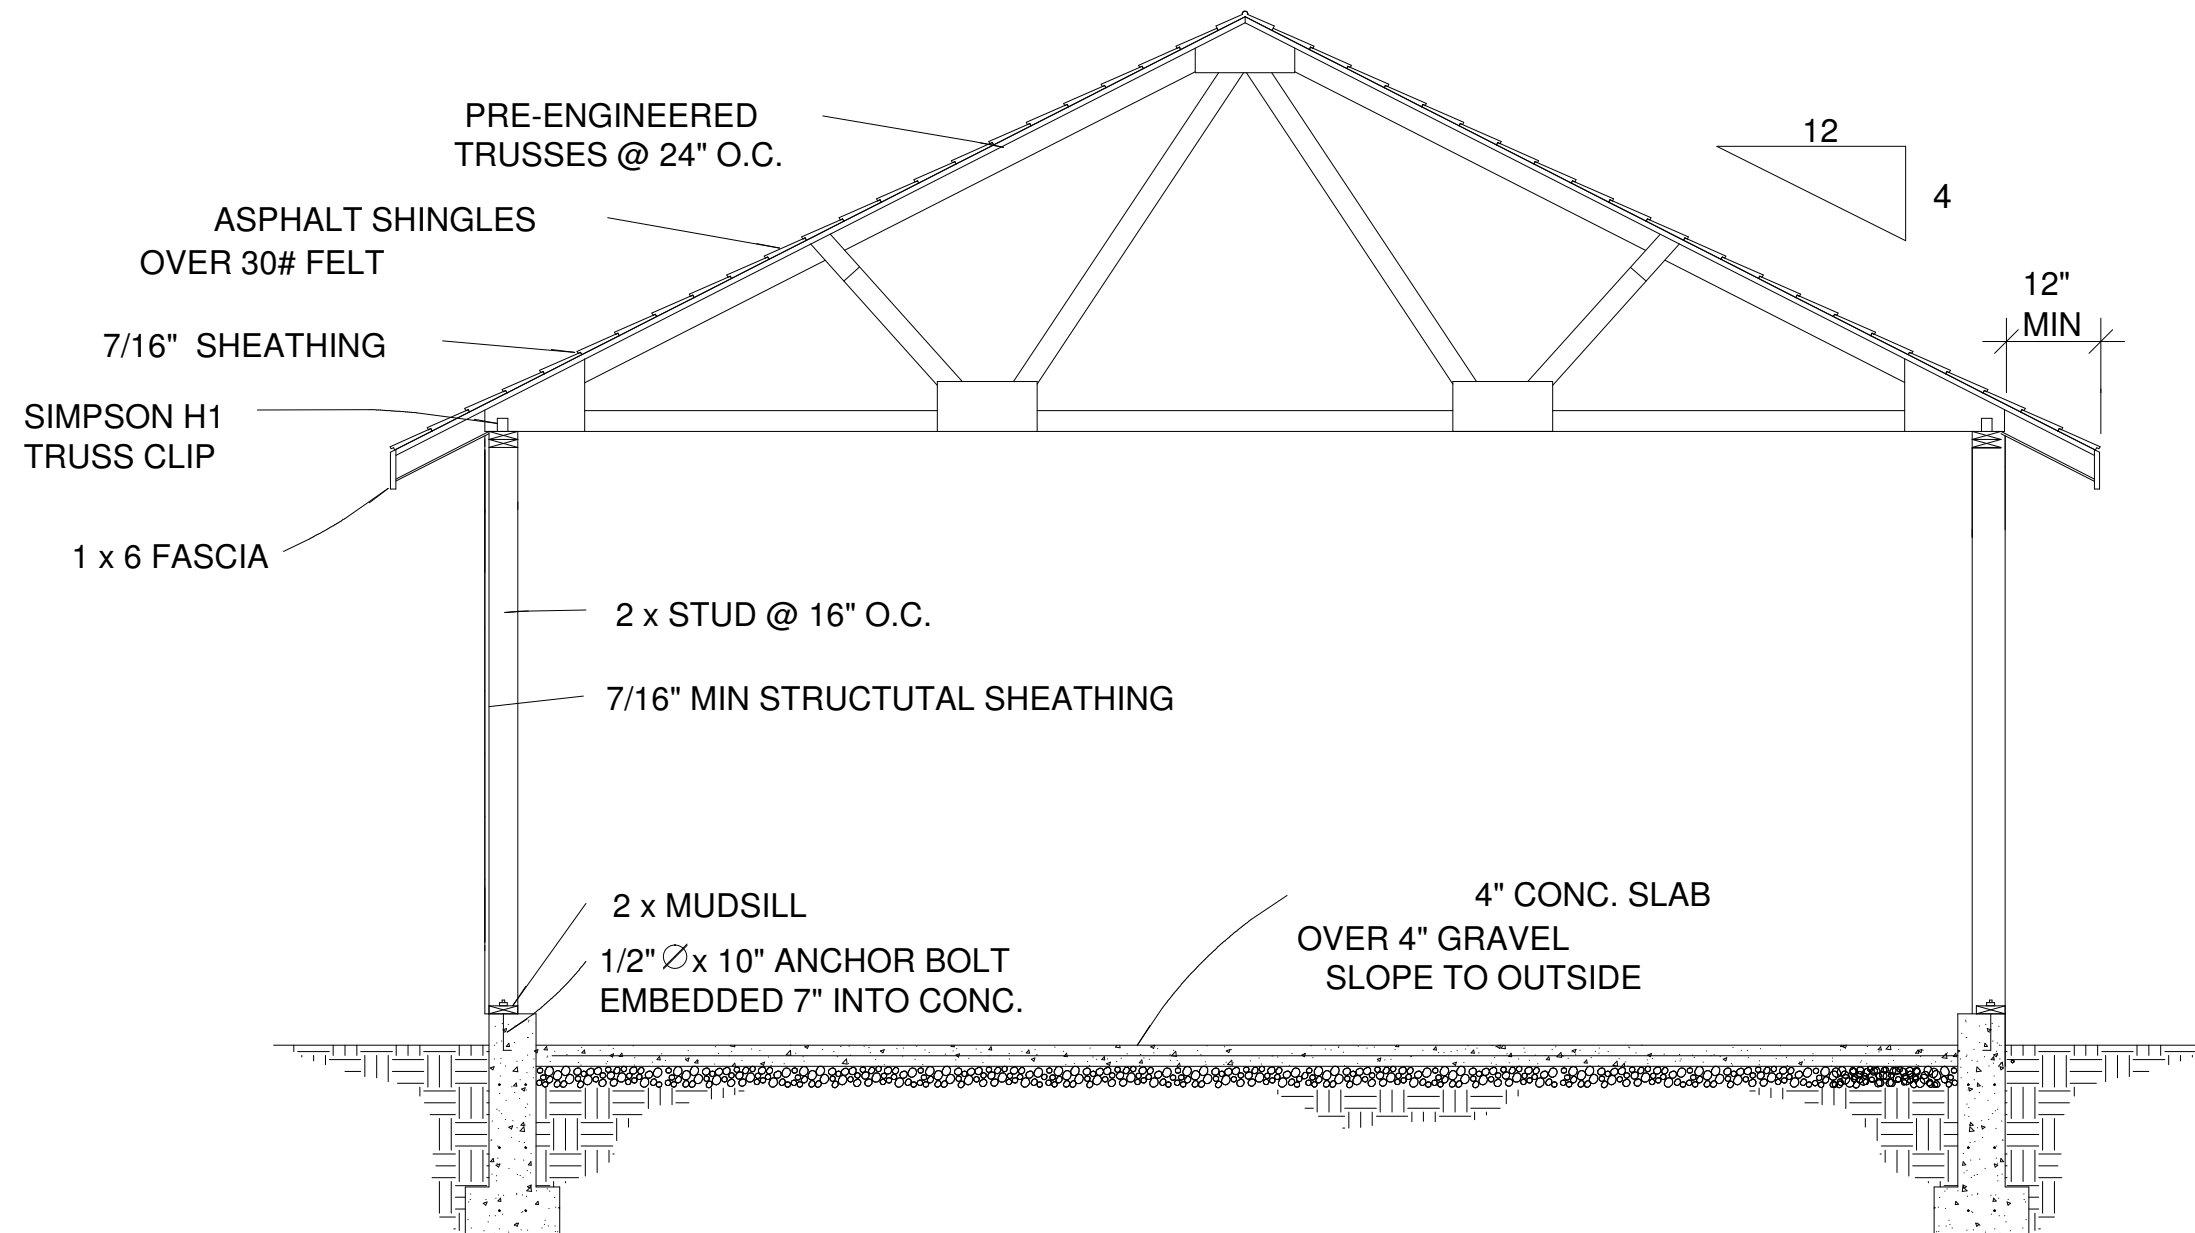

°GARAGE TYPICAL SECTION°

